

Electric Dehumidifier

ROSAHL

Instruction Manual

Separate Type

RDHB-5J1 / RDHB-7J1 / RDHB-10J1

NOTICE

1. Please read this manual before you use ROSAHL and use it correctly.
2. Please keep this manual to the person who operates, manages and maintains ROSAHL.



RYOSAI TECHNICA CO., LTD.

8-1-1 Tsukaguchi-Honmachi
Amagasaki-City, Hyogo, 661-0001 Japan
Phone : +81-6-6497-9078 Fax : +81-6-6497-9082

For Proper Usage

- Use ROSAHL with 100/200V AC.

In order to avoid fire, electrical leakage and damage for ROSAHL.



Prohibited

- DO NOT expose the moisture discharging side of a membrane directly to the winds and rain. When using outdoors, Please attach a rainproof cover (option parts) or a cover to protect a membrane from water.



Prohibited

- Keep the moisture discharging side of membrane well ventilated.



Prohibited

- DO NOT put pin or wire etc into the membrane. It may cause an electric shock and the membrane may be damaged or deteriorate.



Prohibited

- **DO NOT use a silicon-based sealing materials** to improve airtightness of a container. Silicon-based sealing materials generate oxime gas and siloxane gas. As a result, the performance of ROSAHL reduce in a short term.



Prohibited

- **DO NOT use ROSAHL with vapor phase corrosion inhibitor** or insect repellent. Do not use ROSAHL in a place having high density of organic gas. The performance of ROSAHL reduce in a short term.



Prohibited

- DO NOT attempt to disassemble, repair or modify ROSAHL. It may cause an electric shock and the performance deterioration, as this may damage it.



Prohibited

Installation

Make a moisture discharging hole and installation hole for the following dimensions on the container and attach ROSAHL with screws.

Note 1) The combination of dehumidifying unit and power supply unit, refer to Table 1.

Note 2) Processed dimensions for Moisture discharging hole and Installation hole, refer to Table 2.

Note 3) Processed dimensions for Rainproof cover, refer to Table 3.

Table 1. Unit combination list

Model name	RDHB-5J1	RDHB-7J1	RDHB-10J1
Dehumidifying unit	S-5J1	S-7J1	S-10J1
Power supply unit	D-3006JW		D-3010JW
Humidity controller unit (Option parts)	C-M1J		





Table 2. Installation dimensions (mm)

Unit	Dehumidifying unit			Power supply unit		Humidity controller unit (Option parts)
	Model name	S-5J1	S-7J1	S-10J1	D-3006JW	D-3010JW
Dim. a	91	118	148	173	216	102
Dim. b	40	50	43.5	84	84	40
Dim. c	60	50	56.5	-	-	-
Dim. d	-	-	100	-	-	-
Dim. e	-	-	75	-	-	-
Dim. f	-	-	88	-	-	-
Dim. g	5	5	5	5	5	5
Dim. h	60	80	100	-	-	-
Dim. k	67	87	117	-	-	-
Reference	Fig.1			Fig.3		Fig.4

Table 3. Rainproof cover installation dimensions (mm)

*Option parts

Model name	S-5J1	S-7J1	S-10J1
Dim. m	135	175	225
Dim. n	55	65	90
Dim. p	70	85	90
Reference	Fig.1		Fig.2
Rainproof cover Model name	For RDH-5J1	For RDH-7J1	For RDH-10J1

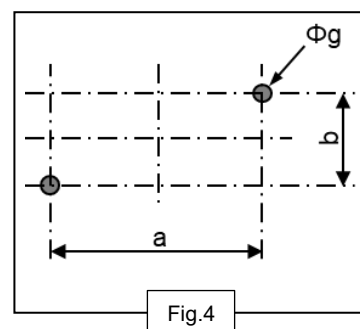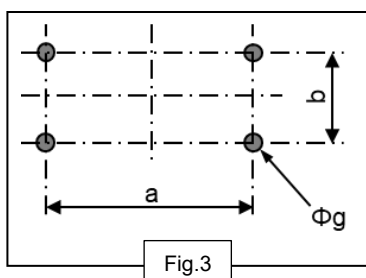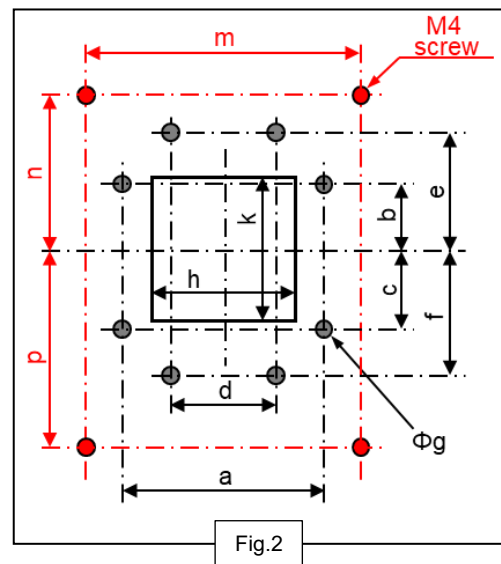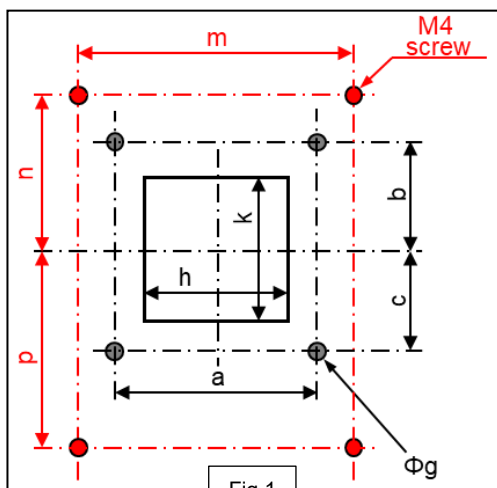

Precautions for Use of ROSAHL

- 1) Confirm the dehumidifying / humidifying surface of a membrane not to get a wrong direction before installation. Attaching ROSAHL by mistake will adversely affect several things in the container.
- 2) Attach ROSAHL in the center of the inner side surface of a container with a gasket.
(Do not attach it on a top or bottom surface.)
- 3) A container must be an airtightness container. If a container has low airtightness and moisture-permeable material, the results may not be what you expected.
- 4) The water vapor goes through a membrane of ROSAHL. If you switch off a power supply, outside water vapor is returned into a container and the humidity is restored.
- 5) If you use ROSAHL with a gasket that contains an antioxidant, crystal materials may be generated on the surface of a membrane. When you choose a gasket, evaluate it enough.
- 6) Do not use silicon-based sealing materials to improve airtightness of a container.
(Silicon-based sealing materials generate oxime gas and siloxane gas.
As a result, the performance of ROSAHL reduces in a short term.)
Additionally, when using any other sealing materials, ROSAHL must be attached after sealing materials are completely cured. Volatile substances generated during curing affect the performance of ROSAHL.
[Recommended products] : modified silicon caulk (Konishi Co., Ltd.)
- 7) Do not expose a moisture discharging side of a membrane to water. When using outdoors, be sure to attach a rainproof cover (option parts) or a cover to protect a membrane from water or insects.
- 8) Attach a moisture-permeable sheet to a membrane to protect ROSAHL from much dust or oil mists.
[Recommended products] : Vent Filter TEMISH S-NTF2131A-S06 (Nitto Denko Corporation)
- 9) Keep the moisture discharging side of a membrane well ventilated.
- 10) Do not use ROSAHL with vapor phase corrosion inhibitor or insect repellent.
Do not use ROSAHL in a place having high density of organic gas.
- 11) Do not do remodeling. ROSAHL may break down.

Usage

*If you do not use the humidity controller unit (option parts), refer to only steps 2 ~ 4.

1 Please set the knob of humidity controller as the right side of it as possible.
(Low humidity side)

2 Please turn on the AC power supply and get energized. (Please use 100/200V AC)

3 Please confirm lighting of the LED.* (It is a usage state)
*Note : It might take 3-5 minutes to light the LED on the initial stage of turning on the power supply.
This is not abnormal.

●Please confirm the following matters when LED doesn't light.

- (1) When LEDs of both the power supply unit and dehumidifying unit do not light
 - a) Is the power supply correctly connected?
 - b) Is the connection between units correctly connected?
 - c) Does not the moisture discharging side of a dehumidifying unit get wet?
(In this case, the overcurrent protection circuit of the power supply functions and LED does not light. If the wet state is canceled, it returns to normal state.)
- (2) When LED of the power supply unit lights and LED of the dehumidifying unit does not light
 - a) Is the power supply unit and the dehumidifying unit connected?
 - b) Is not the polarity of wiring between the power supply unit and the dehumidifying unit wrong?

4 Please adjust the voltage of the power supply unit in the range of 2.9 ~ 3.3V DC at the terminal block of the dehumidifying unit after 15-20 minutes the LEDs of both the power supply unit and the dehumidifying unit light.

*The location of voltage adjustment hole, refer to Fig.6 on page 5.

5

Please set the knob of humidity controller at the value you want.

●Precautions for Humidity Controller

- (1) The humidity controller only turns on / off the dehumidification function, and does not have the function that keeps inside of a container at the specified humidity.
- (2) There may be a gap about $\pm 10\%$ from the set value. Also, the conditions of use and depending on changes in the surrounding environment, the gap may become even larger. So please consider the set value as a guide only. We do not guarantee the accuracy.
- (3) Please turn the knob of humidity controller slowly.

Specifications

■Dehumidifying unit

Model Name		S-5J1	S-7J1	S-10J1
Items				
Dehumidifying Performance	(g/day) ^{*1}	8	16	29
Applicable Volume	(m ³) ^{*2}	~ 1	~ 2	~ 4
Rated Voltage	(V)	3 DC		
Power Consumption	(W) ^{*3}	4	8	14
Dimensions	(mm) ^{*4}	130×111×30	150×138×30	185×168×30
Weight	(kg)	0.4	0.5	0.7
Operating Temperature	(deg C)	-10 ~ 50		

Notes

- *1 The initial value at the temperature of 30 deg C and humidity 60%RH.
(The dehumidifying performance will reduce during use. How much it degrades depends on the operating environment and conditions. If any signs of abnormality are seen, early replacement is recommended.)
- *2 The applicable volume is for a sealed, moisture-impermeable container, and may vary depending on the material of the container, state of sealing and required humidity.
- *3 The annual average power consumption in average condition in Japan.
- *4 Dimensions show the values of H × W × D in the figure on next page.

■Power supply unit

Model Name		D-3006JW	D-3010JW
Items			
Dehumidifying Unit		S-5J1·S-7J1	S-10J1
Rated Input Voltage	(V)	85 ~ 264 AC	
Rated Power Consumption	(VA) ^{*5}	24	40
Rated Output Voltage	(V) ^{*6}	3 DC (6A)	3 DC (10A)
Dielectric Strength	(V)	2000 AC (per minute)	
Dimensions	(mm) ^{*7}	100×182×41	100×225×41
Weight	(kg)	0.7	0.9
Operating Temperature	(deg C)	-10 ~ 50	

Notes

- *5 Power consumption when rated load is connected.
- *6 The value in () is the rated output current.
- *7 Dimensions show the values of H × W × D in the figure on next page.

■Humidity controller unit (Option parts)

Model Name		C-M1J
Items		
Dielectric Strength	(V)	2000 AC (per minute)
Dimensions	(mm) ^{*8}	112×78×35
Weight	(kg)	0.2
Humidity Set Range	(%RH)	20 ~ 80
Operating Temperature	(deg C)	-10 ~ 50

Notes

- *8 Dimensions show the values of H × W × D in the figure on next page.

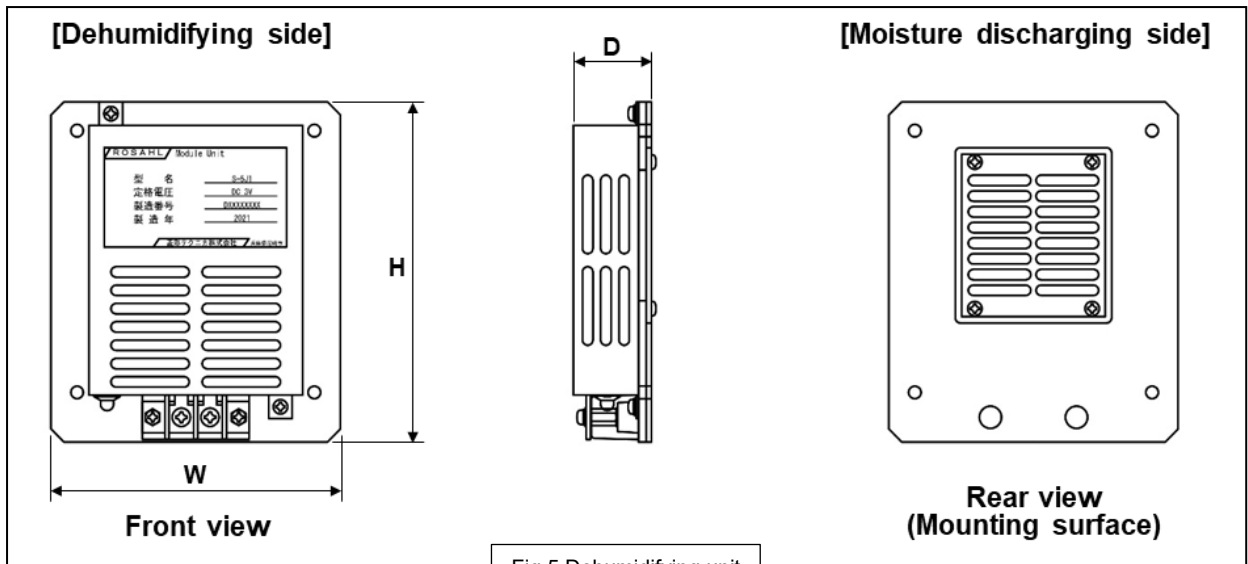


Fig.5 Dehumidifying unit

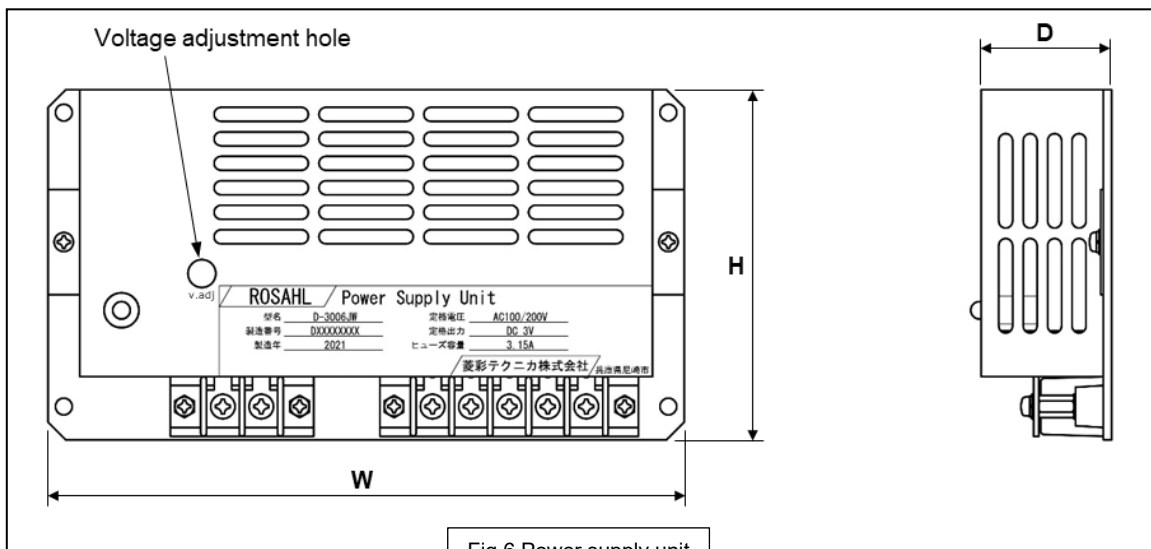


Fig.6 Power supply unit

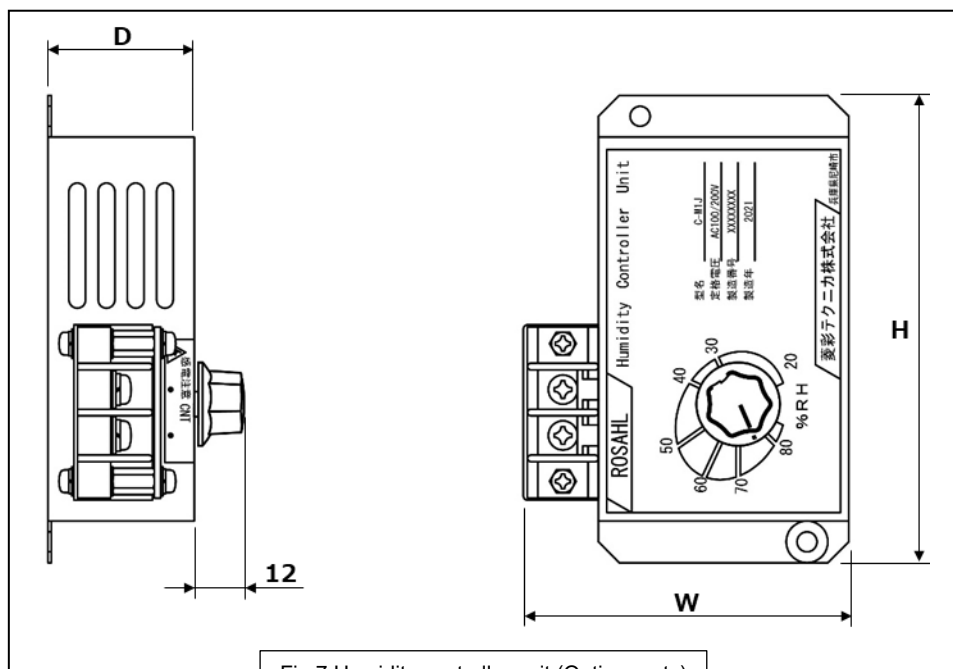


Fig.7 Humidity controller unit (Option parts)

Prohibited Substances and Recommended Materials for ROSAHL

1. Prohibited substances

The substances which adversely affect ROSAHL and harm in response to ROSAHL are as follows.

The anode side is affected mainly. Even the additives of materials may be affected.

Please evaluate enough when a new substance is adopted or a maker is changed.

Classification	Substance Name	State	Notes
Inorganic Matter	hydrochloric acid gas	gas	
	nitric acid gas	gas	
	other corrosion gases	gas	
	SOx gas	gas	
	NOx gas	gas	
	chlorine gas	gas	
	sulfurous acid gas	gas	
	other pollution gases	gas	
	concentrated hydrochloric acid	liquid	
	concentrated nitric acid	liquid	
	substance which produces other corrosion gas	liquid	
	divalent metal ion	liquid	
Organic Matter	siloxane gas	gas	
	oxime gas	gas	
	lamp black	gas	
	diethylamine	gas	
	other amine-based gas	gas	
	amide-based low molecular weight compound	gas, liquid	
	methylene chloride	liquid	
	perchloroethylene	liquid	
	trichloroethylene	liquid	
	perchloroethylene	liquid	
	tetrachloroethylene	liquid	
	other chlorinated solvent	liquid	
	oil mist	liquid	
	dimethyl sulfoxide	liquid	
	other sulfur based organic solvent	liquid	
	silicone sealant	solid	These substances produce siloxane gas. Heat treatment (bake) is necessary to remove low molecule siloxane of non-reaction.
	silicone grease	solid	
	silicone rubber	solid	
	silicone-based sealing compound	solid	
	other siloxane chemical compound	solid	
	pran-ace	solid	
	camphor	solid	
	other insect repellent	solid	
	paradichlorobenzene	gas, liquid	
	other chlorine-based insect repellent	gas, liquid	
	vapor phase inhibitor	liquid, solid	
	corrosion inhibitor which is added in materials	liquid, solid	
cigaret tar constituent	gas, liquid		
2,6-Di-tert-butyl-4-methylphenol (BHT)	liquid	The antioxidant which was added in packing	

2. Recommended Materials

The recommended materials in a range understanding in us are as follows.

Classification	Material Name	Notes
Frame	Glass , Metal , Acrylic , Plastic	The acrylic and plastic resin has moisture permeability. Please thicken the board thickness when using them.
Sealing Compound	the material which does not include "Silicon group" [Recommended products] modified silicon caulk (Konishi Co., Ltd.)	Do not use silicon-based sealing compounds. In addition, about the recommendation product, please operate ROSAHL after completely cured. (Please avoid operating ROSAHL before curing.)
Adhesive	the material which does not include "Silicon group" [Recommended products] Silex, SL220W, SL220LB (Konishi Co., Ltd.)	Do not use silicon-based adhesives.
Gasket	Silicon rubber (secondary vulcanization finished) EPT rubber [Ethylene-propylene] (single bubble) PTFE rubber [Polytetrafluoroethylene]	About the silicon rubber, please perform secondary vulcanization by all means. (ex. 200 deg C / 6 hours) In addition, we don't evaluate all silicon rubber, EPT rubber, PTFE rubber. Please evaluate enough when using them.

The above are just as of April 1, 2021 but not all of them. Please verify in advance and evaluate enough when using our electric dehumidifier "ROSAHL". We don't take any responsibility or liability for any damage or loss caused through the unknown phenomenon and the wrong usage.

Precautions in the Use for the Storage Cabinet

1. When you use ROSAHL to dehumidify into the storage cabinet, do not store volatile rust preventive or things that organic gas volatilizes. The volatile gas which is released from goods reacted at a membrane's anode and new harmful gas is produced.
As a result, not only it causes decrease in performance of ROSAHL, but also it might adversely affect on goods in the storage cabinet. We cannot guarantee even if harm occurs to the stored valuables under the influence of new produced gas. Please evaluate enough when you use ROSAHL for the storage cabinet.
2. The maker who produces and sells storage cabinet equipped with ROSAHL should explain that enough for end users using the storage cabinet.